


Predefined EMF Audits – Quarter 1 2025

Measurements include areas which are of public concern.

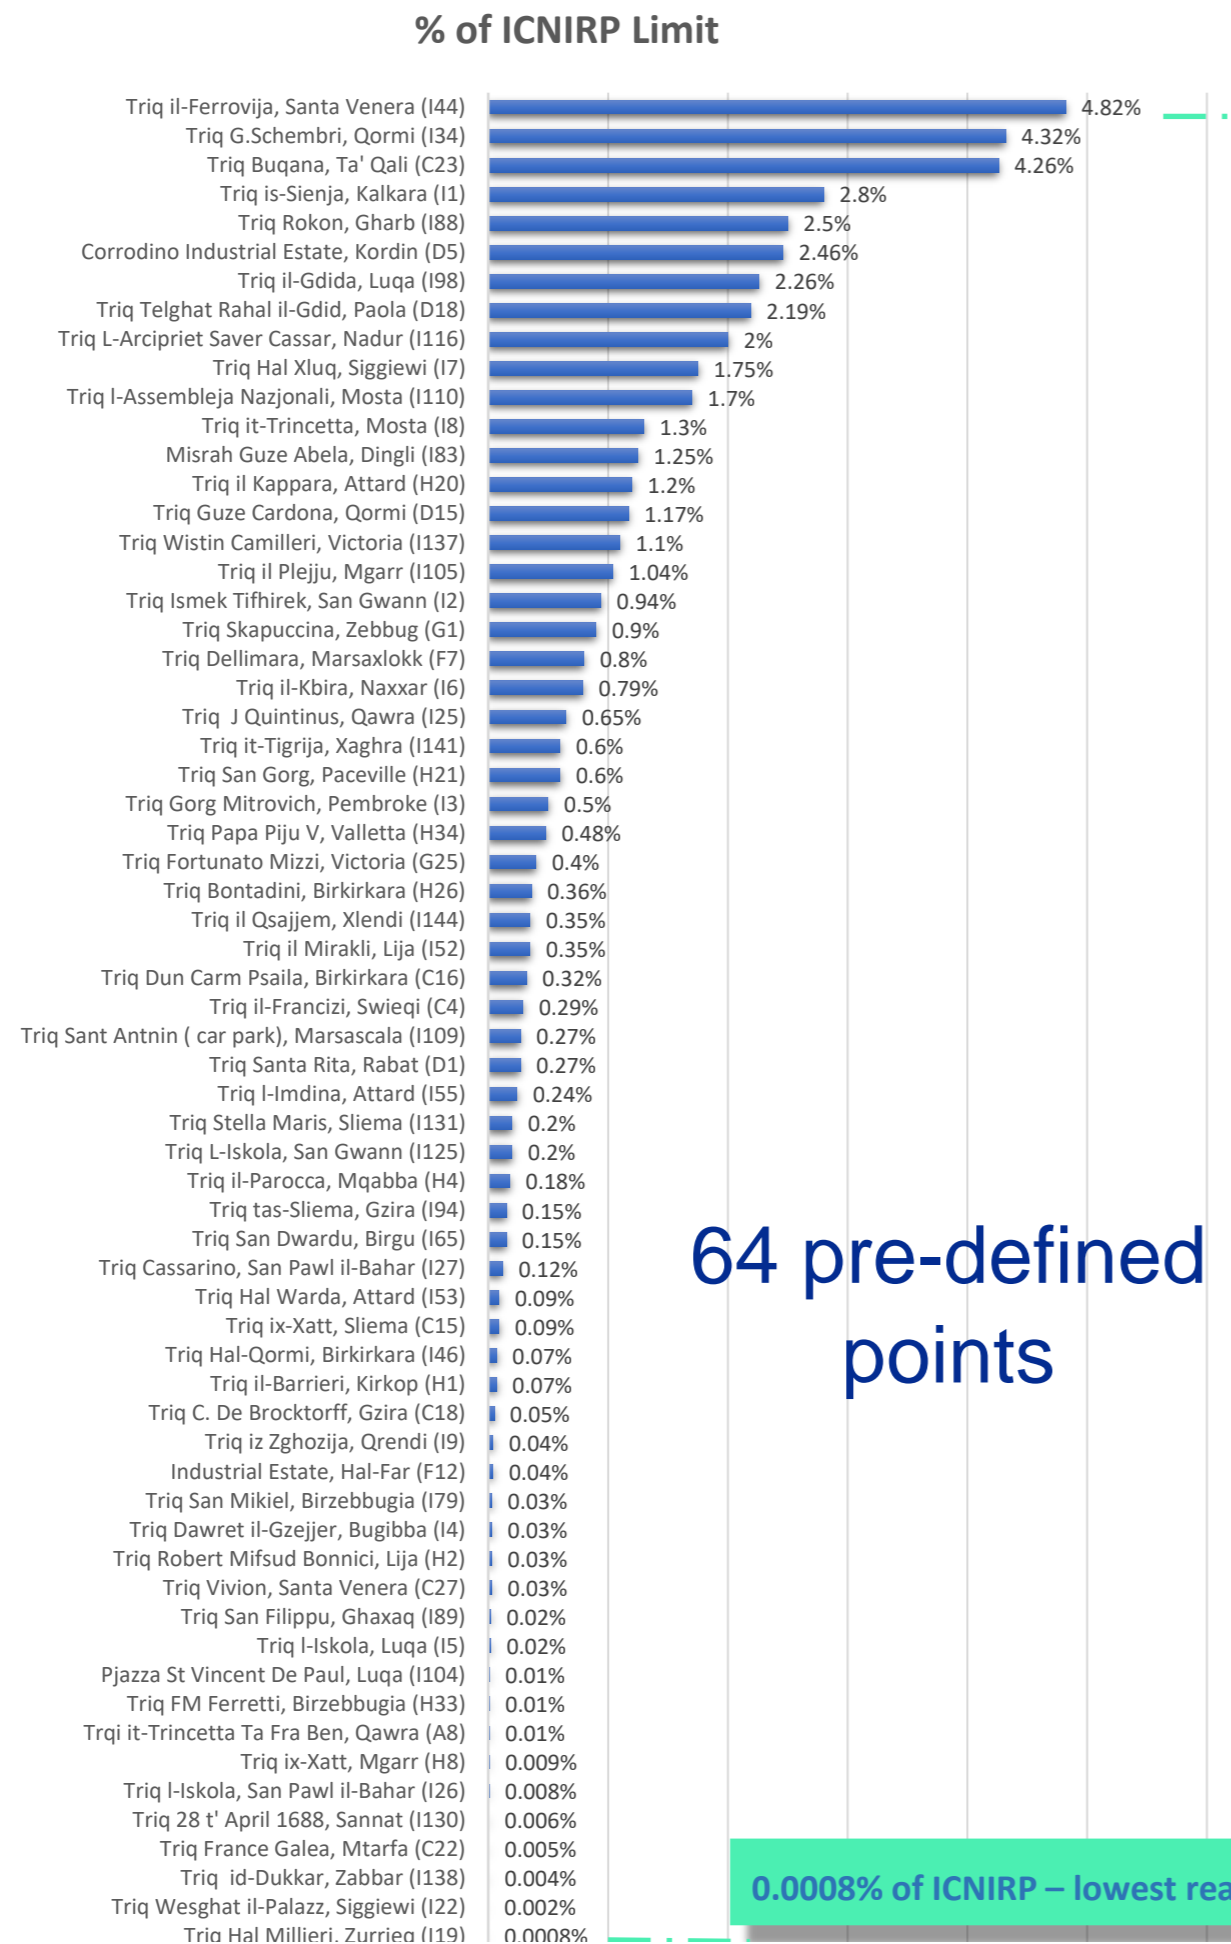


4.82% of ICNIRP – highest reading

64 pre-defined points

0.0008% of ICNIRP – lowest reading

Location of Measurement Points (Q1 2025)

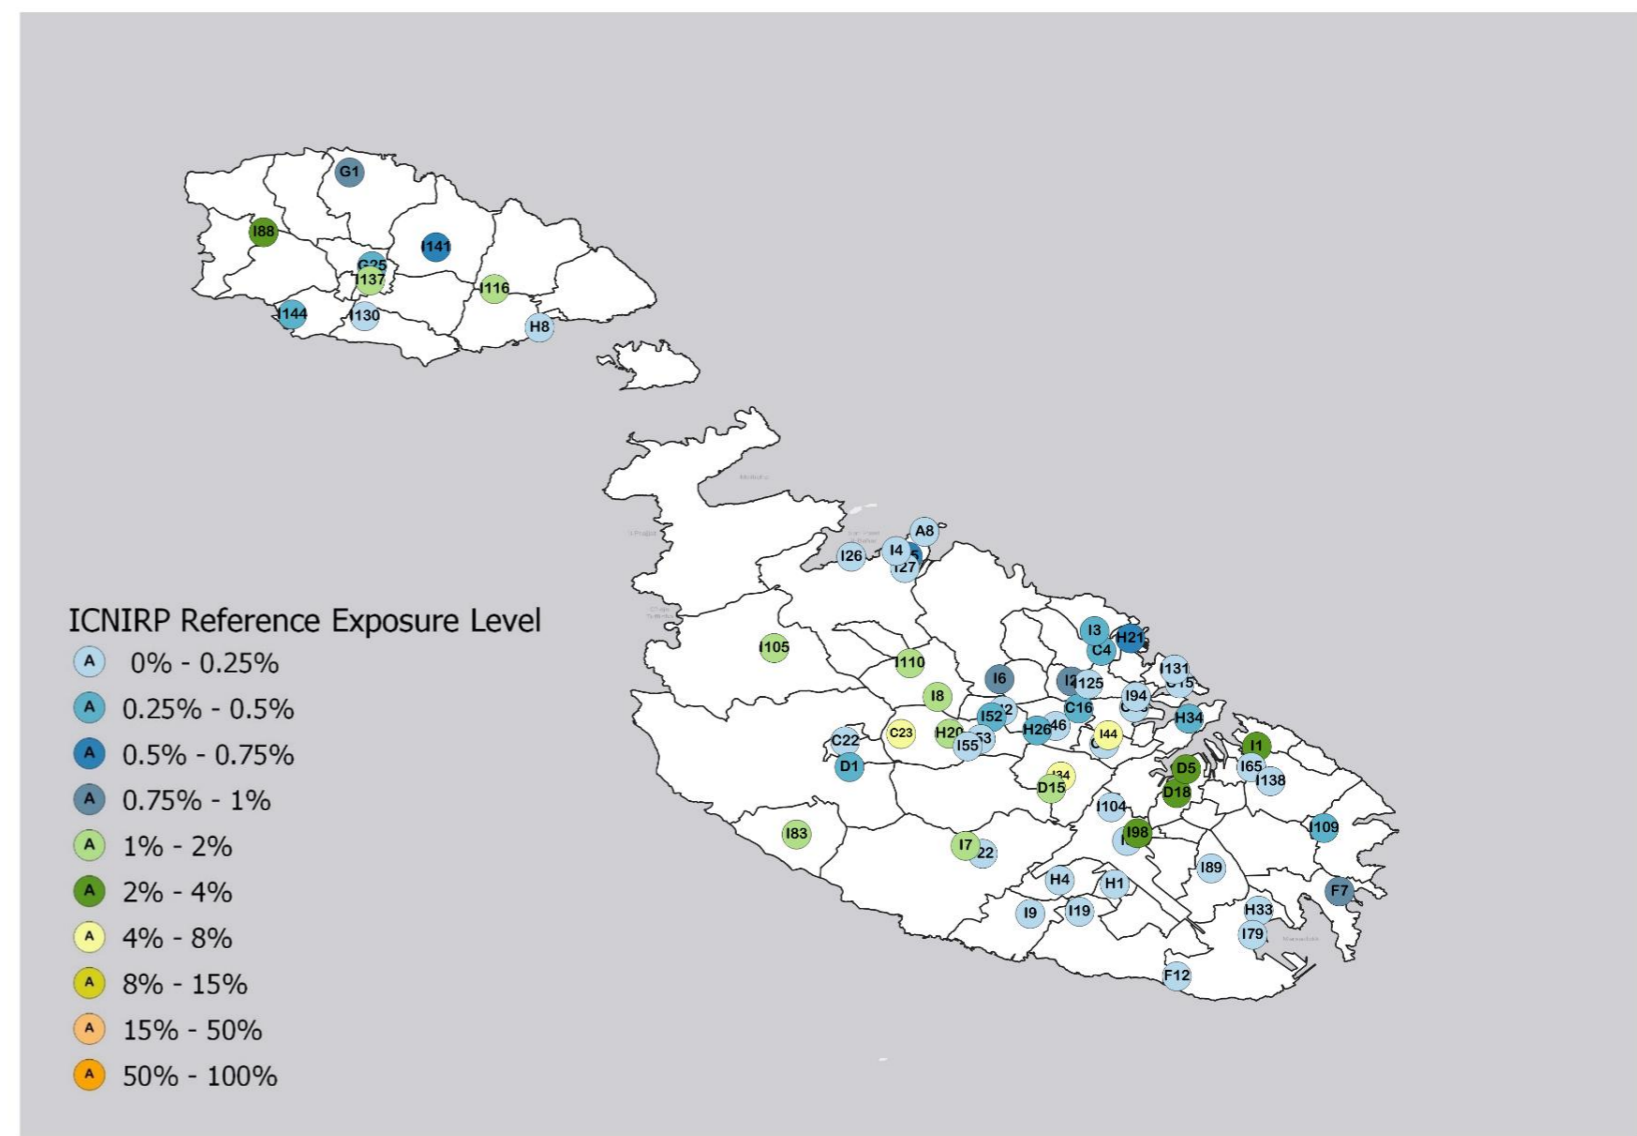

All measurements resulted in aggregate readings well within the ICNIRP limits.

Measurements are taken at street level, using a Narda SRM3006 meter, and are in line with EN 62232. A total of 221 predefined, audit points are measured on a yearly basis. The 64 points measured in Q1 are a subset of these points.